



PUNE MUNICIPAL CORPORATION

Date: 26/10/2023

Parvati Water Works Laboratory

Report ID : CH116

Report of Water Samples Collected as on 23/10/2023

Challan No: 12423000008 Challan Date: 23/10/2023 Amount (Rs.): 1620.0


Name of the owner : Jnana Prabodhini Prashala, 510, Sadashiv Peth

1) Potable Water Sample at Jnana Prabodhini Prashala, 510, Sadashiv Peth, Pune- 411030

As per I.S Standard No. 10500:2012				
Parameter	Results	Desirable Limit	Permissible Limit	Unit
PH	7.58	Between 6.5 To 8.5	No Relaxation	-
Turbidity	1.0	Max 1	Max 5	N.T.U
Total Hardness (ns CaCO)	55.0	Max 200	Max 600	PPM
Chlorides (as Cl)	16.0	Max 250	Max 1000	PPM
Alkanity (as calcium carbonate)	67.0	Max 200	Max 600	PPM
Nitrate Nitrogen (as NO ₃)	1.4	Max 45	No relaxation	PPM
Nitrite Nitrogen (as NO ₂)	0.04	-	-	PPM
Coliform	0	0	0	100ml
E-Coli	0	0	0	100ml
Residual Chlorine Test	0.3	0.2		PPM

Remark: The said sample has been brought by the owners themselves. The above sample is assumed to be representative. This report is for personal information only and this office will not be responsible for any legal issues arising out of its use. Also the origin of the samples has not been verified through this office.

Remark: The water in Sample1 is potable water.

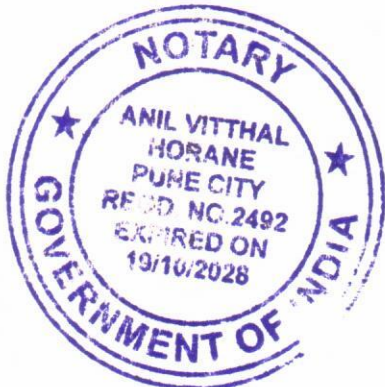

True Translation
Marathi to English

A.V. Horane
A.V. HORANE
ADVOCATE & NOTARY
GOVT. OF INDIA
PUNE

26/10/2023

Chemist
Parvati Water Center
Pune Municipal Corporation

18 APR 2024